


Clear the counter on Fujitsu 7160

How to reset counter Fujitsu 7160 scanner

Resetting the Sheet Counter

1. Confirm that the scanner is connected to the computer, then turn on the scanner.
2. Open the [Software Operation Panel] window.
 - Windows XP/Windows Vista/Windows Server 2008/Windows 7
Select [Start] menu → [All Programs] → [fi Series] → [Software Operation Panel].
 - Windows Server 2012/Windows 8
Right-click the Start screen, and select [All apps] on the app bar → [fi Series] → [Software Operation Panel].
 - Windows Server 2012 R2/Windows 8.1
Select [I] on the lower left side of the Start screen → [Software Operation Panel] under [fi Series].
To display [I], move the mouse cursor.
3. From the listing on the left, select [Device Setting].

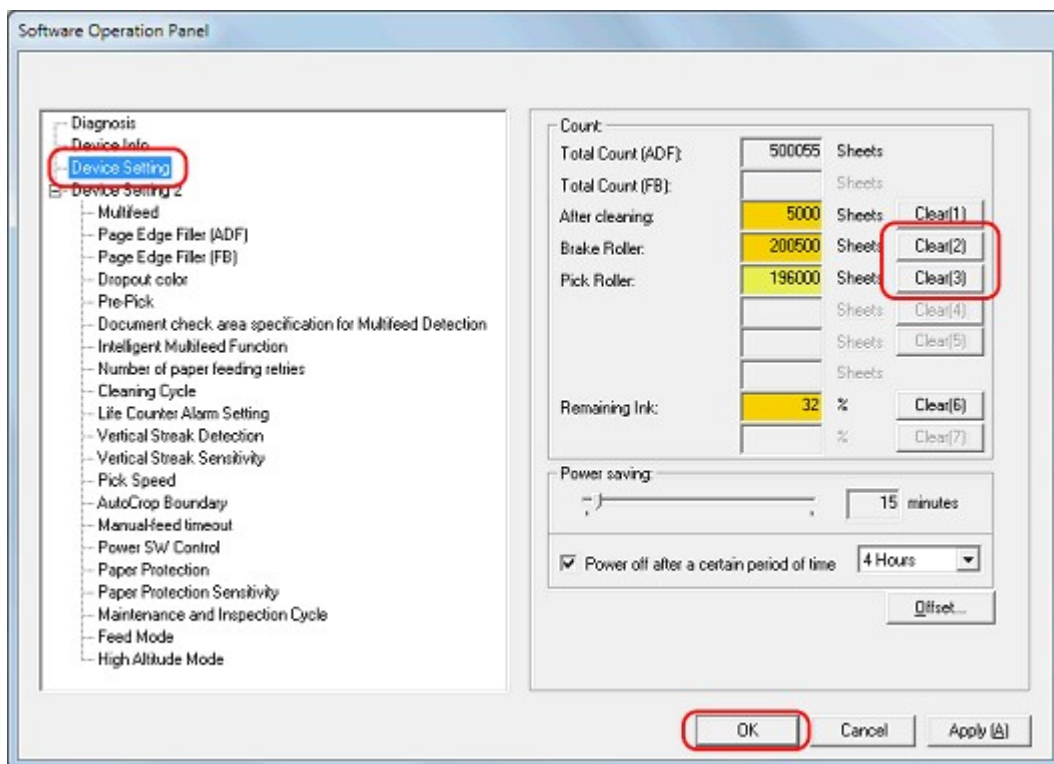

4. Click the [Clear] button for the consumable that you replaced.
→ The counter is reset to "0".
5. Click the [OK] button on the [Software Operation Panel] dialog box.
→ A message appears.

6. Click the [OK] button.

→ The settings are saved.

<http://www.fujitsu.com/global/support/products/computing/peripheral/scanners/erg/replacing.htm>
!